

SEE ENCLOSURE
CONSTRUCTION
NOTE 10

Underwriters Laboratories Inc.
File No. E62062

TESCO TESCO CONTROLS INC.
916-385-9800
SACRAMENTO, CA.

1-
26-100

INDUSTRIAL CONTROL PANEL




| VOLTAGE | PHASE | WIRES | MAINS AMPERES | HZ |
|---------|-------|-------|------------------|----|
| 120/240 | 1 | 3 | 100 | 60 |

SUITABLE FOR USE ON A CIRCUIT CAPABLE OF
DELIVERING NOT MORE THAN:

| AMPERES | RMS SYM. | VOLTAGE |
|---------|----------|---------|
| 10,000 | | 240 V |

METER SOCKET RATING 100 A. CONT.
ENCLOSURE: TYPE 3R

**SUITABLE ONLY FOR USE AS
SERVICE EQUIPMENT**

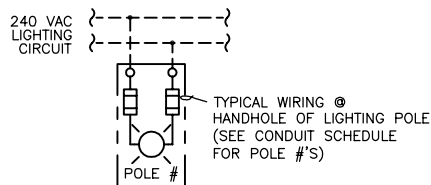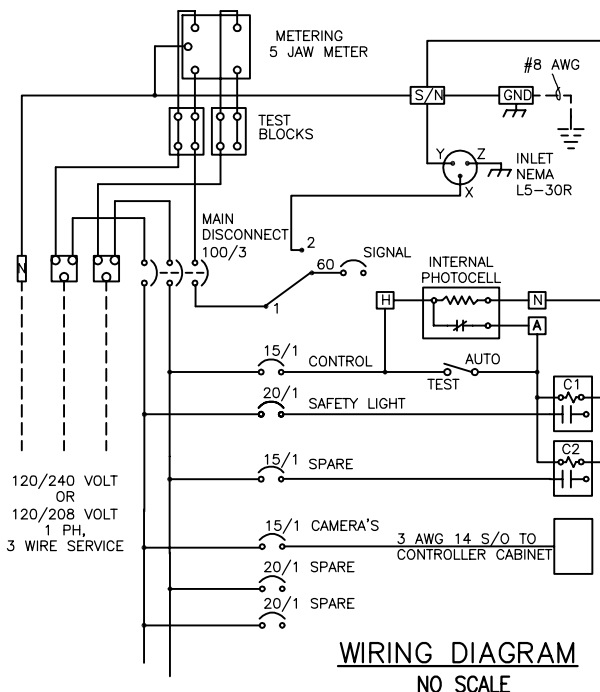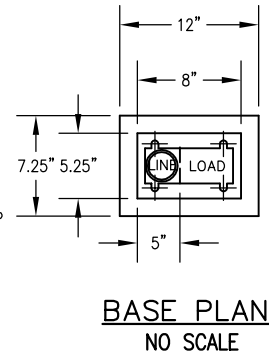

ENCLOSURE CONSTRUCTION NOTES:

1. FABRICATED FROM 1/8" ALUMINUM SHEET STOCK ELECTRICALLY WELDED AND REINFORCED WHERE REQUIRED.
2. CONSTRUCTION WILL BE NEMA 3R AND 12, RAIN TIGHT AND DUST TIGHT.
3. ALL NUTS, BOLTS, SCREWS AND HINGES SHALL BE STAINLESS STEEL.
4. NUTS, BOLTS & SCREWS SHALL NOT BE VISIBLE FROM OUTSIDE OF ENCLOSURE.
5. PHENOLIC NAMEPLATES SHALL BE PROVIDED AS REQUIRED.
6. CONTROL WIRING SHALL BE MARKED AT BOTH ENDS BY PERMANENT WIRE MARKERS.
7. A PLASTIC COVERED WIRING DIAGRAM SHALL BE ATTACHED TO THE INSIDE OF THE FRONT DOOR.
8. ENCLOSURE WILL BE FACTORY WIRED AND CONFORM TO REQUIRED NEMA STANDARD.
9. FINISH: ANODIZED ALUMINUM
10. PANEL SHALL BE TESCO TYPE III AF OR APPROVED EQUAL.



DRAWN BY: M. LEE
CHECKED BY: D. PITTON
APPROVED BY: T. SUPAN
DATE: AUGUST 2006

TRAFFIC SIGNAL POWER PANEL

CITY OF SANTA CLARA

TR-3

PAGE: 40